


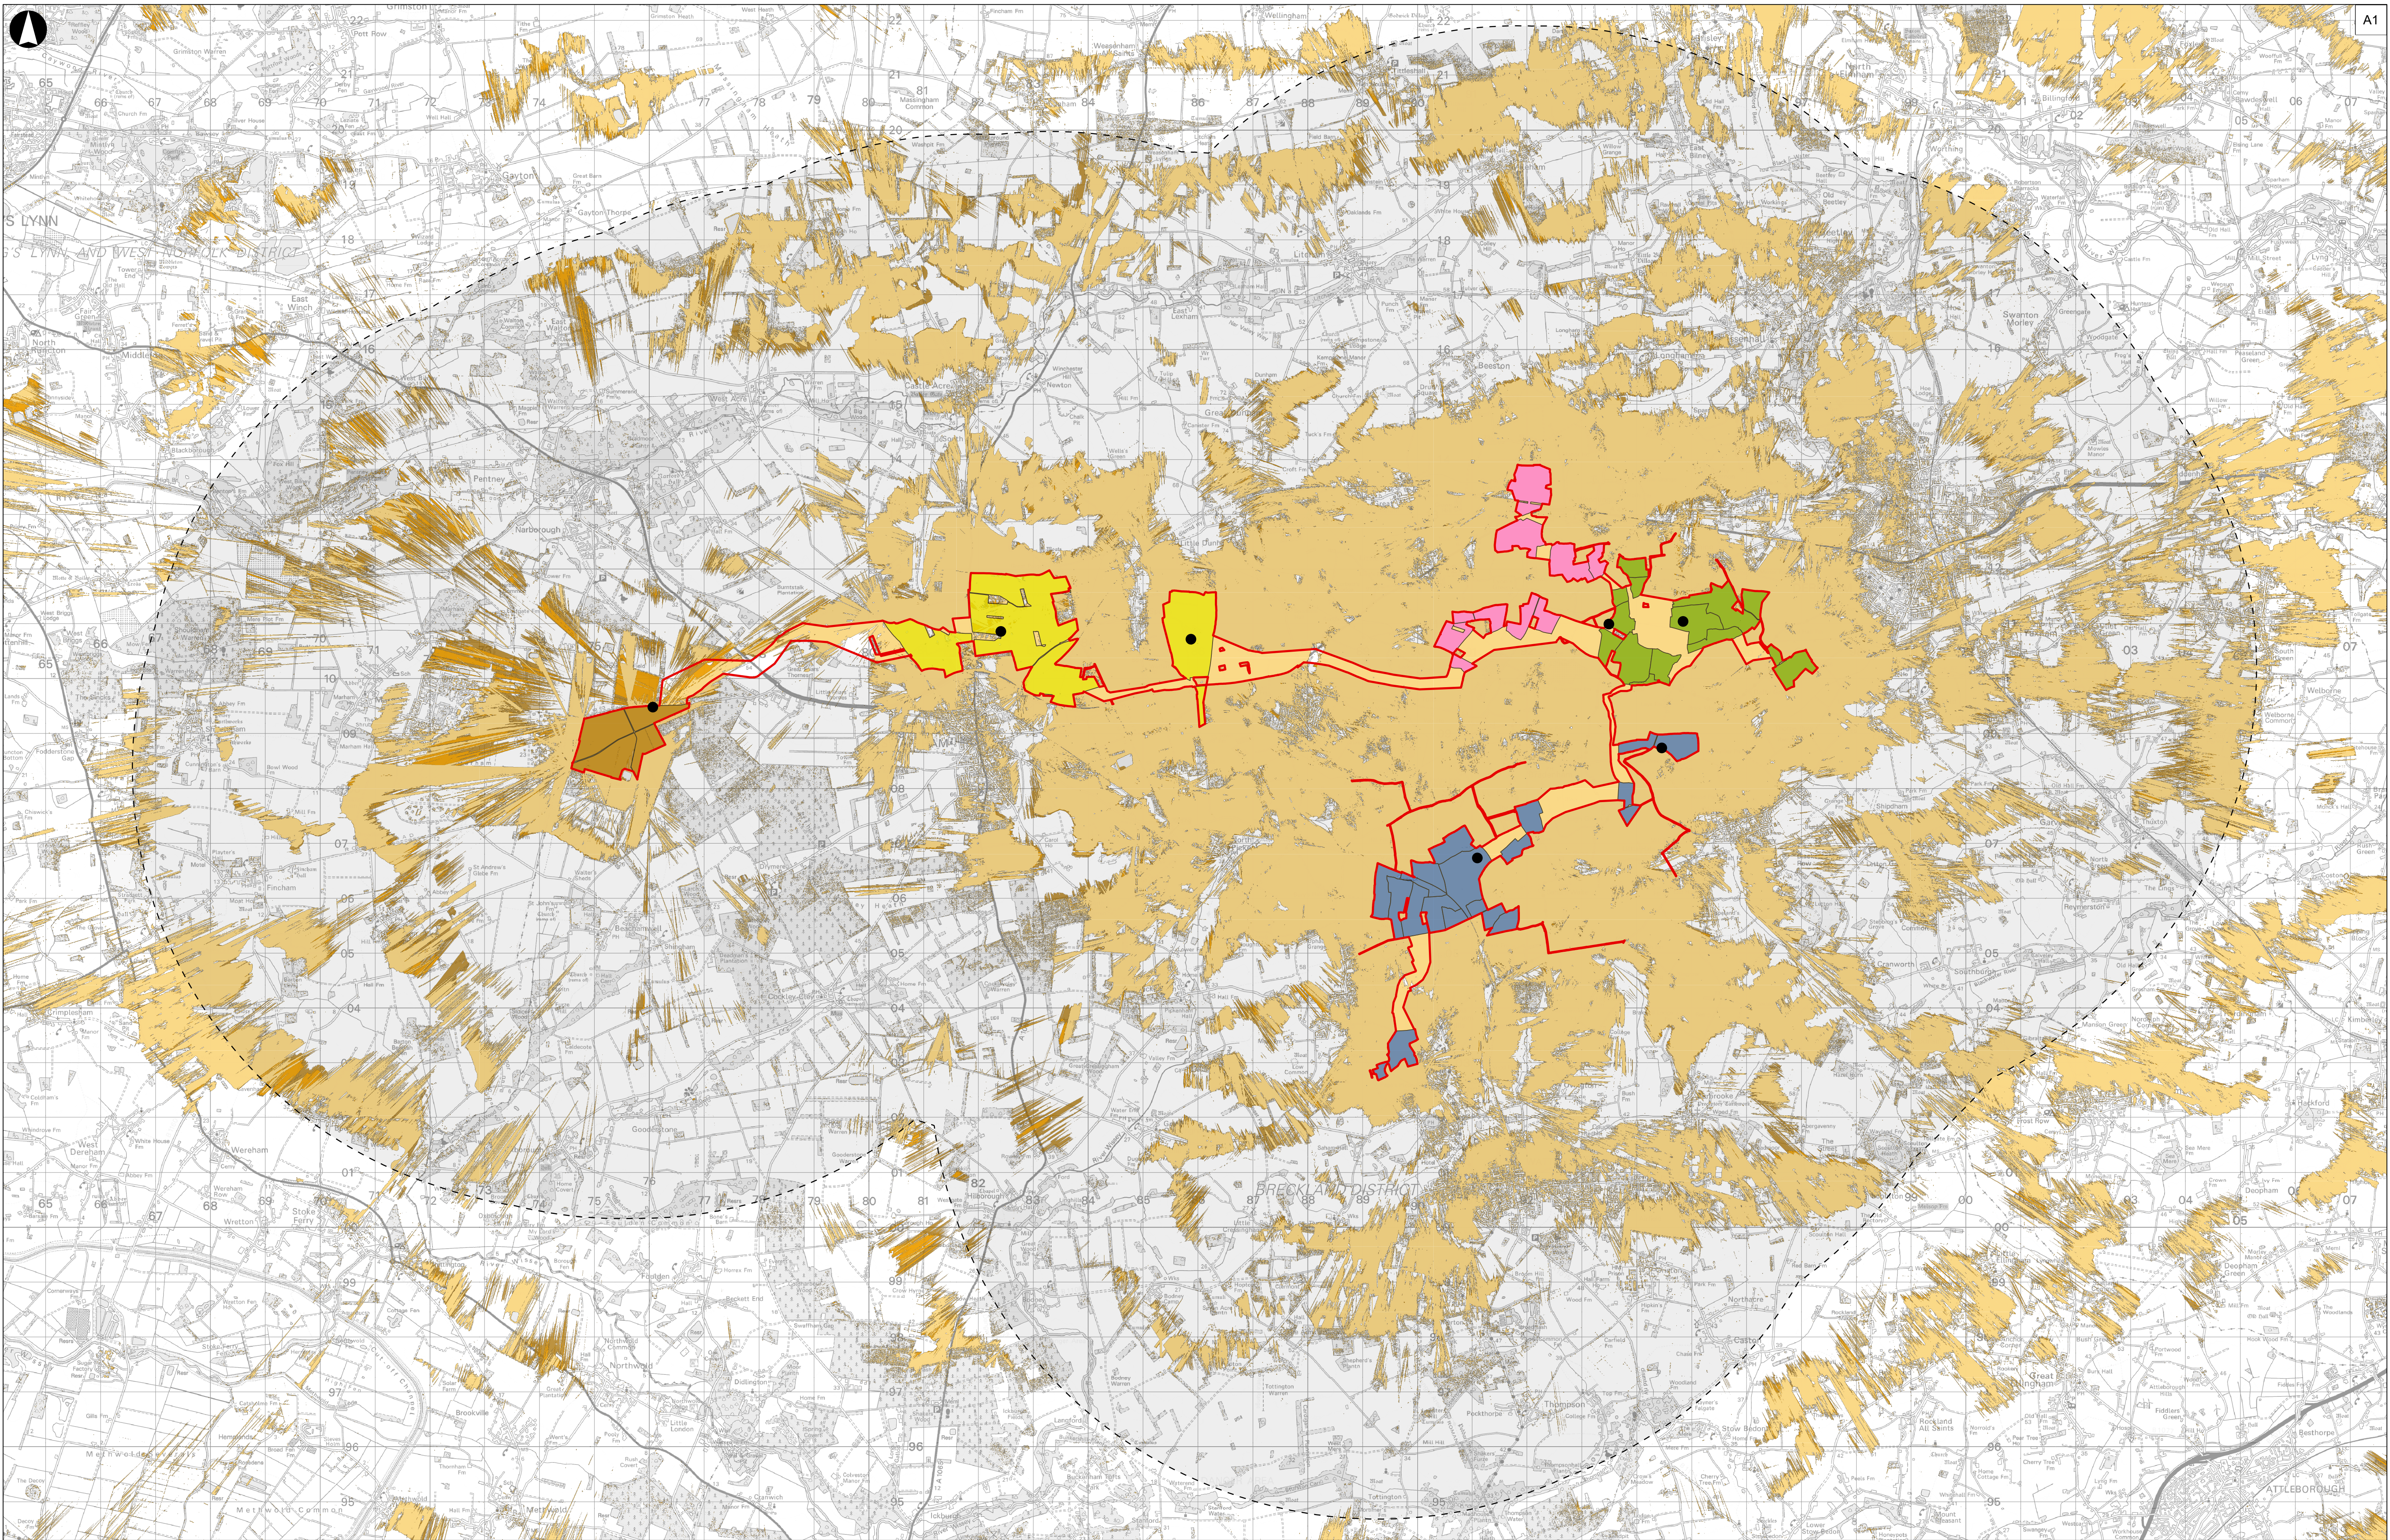

Legend

- draft Order Limits
- Panel Area and Cable Corridor 8km Buffer
- Panel Areas**
- Central
- Eastern
- Northern
- Southern
- Western
- 132 kV Substation
- Panel Area Viewshed (DSM)
- 3m Height Panel Area Visibility
- 132kV Substation
- 8m Height Electrical Equipment Visibility
- 15m Height Communications Tower Visibility

Coordinate System: British National Grid

© Crown copyright and database rights 2024 Ordnance Survey A2000889122

P01	11/04/2025	JEP	DW	HJ	CS
Rev	Date	By	Chkd	Appd	Authd

Client

RWE

Project Name

High Grove Solar

Drawing Title

Figure 10.14 Zone of Theoretical Visibility (ZTV) - with screening

Scale at A1

1:55,000

Role

PEIR

Suitability

Issue

Project Number

300883-00

Drawing Name

HGS-PEIR10-00014

Rev

P01